

Susceptibility Report for System ID 0200230

System Details

Water System ID	0200230
System Name	CITY OF OYSTER CREEK
Address	3210 FM 523 RD OYSTER CREEK, TX 775416613
County	BRAZORIA
Telephone	9792330243
PWS Type	C
Total Production	0

Ground Water Sources

Source ID	Drill Date	Top Screened Interval (Ft.)	Bottom Screened Interval (Ft.)	Pumpage Rate (GPM)	Entry Point	Operational Status
G0200230A		205	235	550	002	Operational
G0200230B		200	250	480	002	Operational

Surface Water Sources

Source ID	Type	Surface Water Body	Entry Point	Operational Status
-----------	------	--------------------	-------------	--------------------

No surface water sources

PWS System Susceptibility Summary: Contaminants with HIGH Susceptibility

The system is rated as having HIGH susceptibility to the contaminants listed below.

D.W. CONTAM. CANDIDATE LIST

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
BORON	Low	Low	High	----	----	----	High
DDE	Low	Low	High	----	----	----	High
DIAZINON	Low	Low	High	----	----	----	High

INORGANICS

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
CHLORIDE	Low	Low	Moderate	----	----	High	High
CYANIDE	Low	Low	High	----	----	----	High
IRON	Low	Low	Low	----	----	High	High
MANGANESE	Low	Low	High	----	----	High	High
TDS	Low	Low	High	----	----	High	High

INORGANICS MONITORED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
SPECIFIC CONDUCTANCE	----	Low	High	----	----	----	High

INORGANICS UNREGULATED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
SODIUM	Low	Low	High	----	----	----	High

PHYSICAL

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
HARDNESS	---	Low	High	---	---	---	High

PHYSICAL PARAMETER

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
pH	Low	Low	High	---	---	---	High

SOC MONITORED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
2,4,5-T	Low	Low	High	---	---	---	High
ALDRIN	Low	Low	High	---	---	---	High
DIELDRIN	Low	Low	High	---	---	---	High

SOC REGULATED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
2,4,5-TP	Low	Low	High	---	---	---	High
2,4-D	Low	Low	High	---	---	---	High
ALACHLOR	Low	Low	High	---	---	---	High
ATRAZINE	Low	Low	High	---	---	---	High
BENZO(A)PYRENE	Low	Low	High	---	---	---	High
CHLORDANE	Low	Low	High	---	---	---	High
ENDRIN	Low	Low	High	---	---	---	High
GLYPHOSATE	Low	Low	High	---	---	---	High
PENTACHLOROPHENOL	Low	Low	High	---	---	---	High
SIMAZINE	Low	Low	High	---	---	---	High

VOC - OTHER COMPOUNDS

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
METHYL-T-BUTYL ETHER	Low	Low	High	---	---	---	High

VOC MONITORED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
1,3-DICHLOROBENZENE	Low	Low	High	---	---	---	High

VOC REGULATED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
1,1,2-TRICHLOROETHANE	Low	Low	High	---	---	---	High
BENZENE	Low	Low	High	---	---	---	High
CIS-1,2-DICHLOROETHYLENE	Low	Low	High	---	---	---	High
DICHLOROMETHANE	Low	Low	High	---	---	---	High
ETHYLBENZENE	Low	Low	High	---	---	---	High
TETRACHLOROETHYLENE	Low	Low	High	---	---	---	High
TOLUENE	Low	Low	High	---	---	---	High
TRANS-1,2-DICHLOROETHYLENE	Low	Low	High	---	---	---	High

TRICHLOROETHYLENE	Low	Low	High	----	----	----	High
VINYL CHLORIDE	Low	Low	High	----	----	----	High
XYLENES (TOTAL)	Low	Low	High	----	----	----	High

PWS System Susceptibility Summary: Contaminants with MODERATE Susceptibility

The system is rated as having MODERATE susceptibility to the contaminants listed below.

D.W. CONTAM. CANDIDATE LIST

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
1,2-DIPHENYLHYDRAZINE	Low	Low	Moderate	----	----	----	Moderate
1,3-DICHLOROPROPENE	Low	Low	Moderate	----	----	----	Moderate
2,4,6-TRICHLOROPHENOL	Low	Low	Moderate	----	----	----	Moderate
2,4-DICHLOROPHENOL	Low	Low	Moderate	----	----	----	Moderate
2,4-DINITROTOLUENE	Low	Low	Moderate	----	----	----	Moderate
2,6-DINITROTOLUENE	Low	Low	Moderate	----	----	----	Moderate
2-METHYLPHENOL	Low	Low	Moderate	----	----	----	Moderate
MOLINATE	Low	Low	Moderate	----	----	----	Moderate
NITROBENZENE	Low	Low	Moderate	----	----	----	Moderate
ORGANOTINS	Low	Low	Moderate	----	----	----	Moderate
PERCHLORATE	Low	Low	Moderate	----	----	----	Moderate
RDX	Low	Low	Moderate	----	----	----	Moderate

INORGANICS

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
ALUMINUM	Low	Low	Moderate	----	----	----	Moderate
BROMIDE	Low	Low	Moderate	----	----	----	Moderate
HYDROGEN SULFIDE	Low	Low	Moderate	----	----	----	Moderate
ZINC	Low	Low	Moderate	----	----	----	Moderate

INORGANICS MONITORED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
MAGNESIUM	Low	Low	Moderate	----	----	----	Moderate

INORGANICS UNREGULATED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
CALCIUM	----	Low	Moderate	----	----	----	Moderate

RADIOCHEM

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
GROSS ALPHA	Low	Low	Moderate	----	----	----	Moderate
GROSS BETA	Low	Low	Moderate	----	----	----	Moderate
RADIUM-226	Low	Low	Moderate	----	----	----	Moderate
RADIUM-228	Low	Low	Moderate	----	----	----	Moderate
STRONTIUM-90	Low	Low	Moderate	----	----	----	Moderate
TRITIUM	Low	Low	Moderate	----	----	----	Moderate

RADIOCHEM UNREGULATED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
RADON	Low	Low	Moderate	----	----	----	Moderate
STRONTIUM-89	Low	Low	Moderate	----	----	----	Moderate
URANIUM	Low	Low	Moderate	----	----	----	Moderate

SOC MONITORED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
ACENAPHTHENE	Low	Low	Moderate	----	----	----	Moderate
ACENAPHTHYLENE	Low	Low	Moderate	----	----	----	Moderate
ANTHRACENE	Low	Low	Moderate	----	----	----	Moderate
BENTAZON	Low	Low	Moderate	----	----	----	Moderate
BENZO[B]FLUORANTHENE	Low	Low	Moderate	----	----	----	Moderate
BENZO[G,H,I]PERYLENE	Low	Low	Moderate	----	----	----	Moderate
BUTYL BENZYL PHTHALATE	Low	Low	Moderate	----	----	----	Moderate
CARBARYL	Low	Low	Moderate	----	----	----	Moderate
CHRYSENE	Low	Low	Moderate	----	----	----	Moderate
DICAMBA	Low	Low	Moderate	----	----	----	Moderate
DIETHYL PHTHALATE	Low	Low	Moderate	----	----	----	Moderate
DIMETHYL PHTHALATE	Low	Low	Moderate	----	----	----	Moderate
DI-N-BUTYL PHTHALATE	Low	Low	Moderate	----	----	----	Moderate
FLUORENE	Low	Low	Moderate	----	----	----	Moderate
PHENANTHRENE	Low	Low	Moderate	----	----	----	Moderate
PYRENE	Low	Low	Moderate	----	----	----	Moderate

SOC REGULATED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
CARBOFURAN	Low	Low	Moderate	----	----	----	Moderate
CHLORDANE (ALPHA-CHLORDANE)	Low	Low	Moderate	----	----	----	Moderate
CHLORDANE (GAMMA-CHLORDANE)	Low	Low	Moderate	----	----	----	Moderate
CHLORDANE (TRANS-NONACHLOR)	Low	Low	Moderate	----	----	----	Moderate
DI-(2-ETHYLHEXYL)ADIPATE	Low	Low	Moderate	----	----	----	Moderate
DI-(2-ETHYLHEXYL)PHTHALATE	Low	Low	Moderate	----	----	----	Moderate
HEXACHLOROBENZENE	Low	Low	Moderate	----	----	----	Moderate
HEXACHLOROCYCLOPENTADIENE	Low	Low	Moderate	----	----	----	Moderate
PCBs	Low	Low	Moderate	----	----	----	Moderate
PICLORAM	Low	Low	Moderate	----	----	----	Moderate

THM

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
BROMOFORM	Low	Low	Moderate	----	----	----	Moderate
CHLOROFORM	Low	Low	Moderate	----	----	----	Moderate

VOC - OTHER COMPOUNDS

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
2-HEXANONE	Low	Low	Moderate	----	----	----	Moderate
4-METHYL-2-PENTANONE (MIBK)	Low	Low	Moderate	----	----	----	Moderate
ACETONE	Low	Low	Moderate	----	----	----	Moderate
ACRYLONITRILE	Low	Low	Moderate	----	----	----	Moderate
CARBON DISULFIDE	Low	Low	Moderate	----	----	----	Moderate

ETHYL METHACRYLATE	Low	Low	Moderate	----	----	----	Moderate
METHYL ETHYL KETONE	Low	Low	Moderate	----	----	----	Moderate
METHYL METHACRYLATE	Low	Low	Moderate	----	----	----	Moderate
TETRAHYDROFURAN	Low	Low	Moderate	----	----	----	Moderate
VINYL ACETATE	Low	Low	Moderate	----	----	----	Moderate

VOC MONITORED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
1,1,1,2-TETRACHLOROETHANE	Low	Low	Moderate	----	----	----	Moderate
1,1-DICHLOROETHANE	Low	Low	Moderate	----	----	----	Moderate
1,1-DICHLOROPROPENE	Low	Low	Moderate	----	----	----	Moderate
1,2,3-TRICHLOROBENZENE	Low	Low	Moderate	----	----	----	Moderate
1,2,3-TRICHLOROPROPANE	Low	Low	Moderate	----	----	----	Moderate
1,2,4-TRIMETHYLBENZENE	Low	Low	Moderate	----	----	----	Moderate
1,3,5-TRIMETHYLBENZENE	Low	Low	Moderate	----	----	----	Moderate
2-CHLOROTOLUENE	Low	Low	Moderate	----	----	----	Moderate
4-CHLOROTOLUENE	Low	Low	Moderate	----	----	----	Moderate
4-ISOPROPYLTOLUENE	Low	Low	Moderate	----	----	----	Moderate
CHLOROETHANE	Low	Low	Moderate	----	----	----	Moderate
CHLOROMETHANE	Low	Low	Moderate	----	----	----	Moderate
CIS-1,3-DICHLOROPROPENE	Low	Low	Moderate	----	----	----	Moderate
DIBROMOMETHANE	Low	Low	Moderate	----	----	----	Moderate
DICHLORODIFLUOROMETHANE	Low	Low	Moderate	----	----	----	Moderate
HEXACHLOROBUTADIENE	Low	Low	Moderate	----	----	----	Moderate
ISOPROPYLBENZENE	Low	Low	Moderate	----	----	----	Moderate
M + P XYLENE	Low	Low	Moderate	----	----	----	Moderate
NAPHTHALENE	Low	Low	Moderate	----	----	----	Moderate
S-BUTYLBENZENE	Low	Low	Moderate	----	----	----	Moderate
TRANS-1,3-DICHLOROPROPENE	Low	Low	Moderate	----	----	----	Moderate
TRICHLOROFLUOROMETHANE	Low	Low	Moderate	----	----	----	Moderate

VOC REGULATED


Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
1,1,1-TRICHLOROETHANE	Low	Low	Moderate	----	----	----	Moderate
1,1-DICHLOROETHYLENE	Low	Low	Moderate	----	----	----	Moderate
1,2,4-TRICHLOROBENZENE	Low	Low	Moderate	----	----	----	Moderate
1,2-DICHLOROETHANE	Low	Low	Moderate	----	----	----	Moderate
1,2-DICHLOROPROPANE	Low	Low	Moderate	----	----	----	Moderate
CARBON TETRACHLORIDE	Low	Low	Moderate	----	----	----	Moderate
CHLOROBENZENE (MONOCHLOROBENZENE)	Low	Low	Moderate	----	----	----	Moderate
MONOCHLOROBENZENE (CHLOROBENZENE)	Low	Low	Moderate	----	----	----	Moderate
M-XYLENE	Low	Low	Moderate	----	----	----	Moderate
ORTHO-1,2-DICHLOROBENZENE	Low	Low	Moderate	----	----	----	Moderate
O-XYLENE	Low	Low	Moderate	----	----	----	Moderate
PARA-1,4-DICHLOROBENZENE	Low	Low	Moderate	----	----	----	Moderate
P-XYLENE	Low	Low	Moderate	----	----	----	Moderate
STYRENE	Low	Low	Moderate	----	----	----	Moderate

Other

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
CRYPTOSPORIDIUM PARVUM	Low	Low	Moderate	----	----	----	Moderate
ESCHERICHIA COLI	Low	Low	Moderate	----	----	----	Moderate
FECAL VIRUSES	Low	Low	Moderate	----	----	----	Moderate

GIARDIA LAMBLIA	Low	Low	Moderate	----	----	----	Moderate
TOTAL ALPHA EMITTING RADIUM	Low	Low	Moderate	----	----	----	Moderate
TOTAL COLIFORM	Low	Low	Moderate	----	----	----	Moderate

Source Details: G0200230A

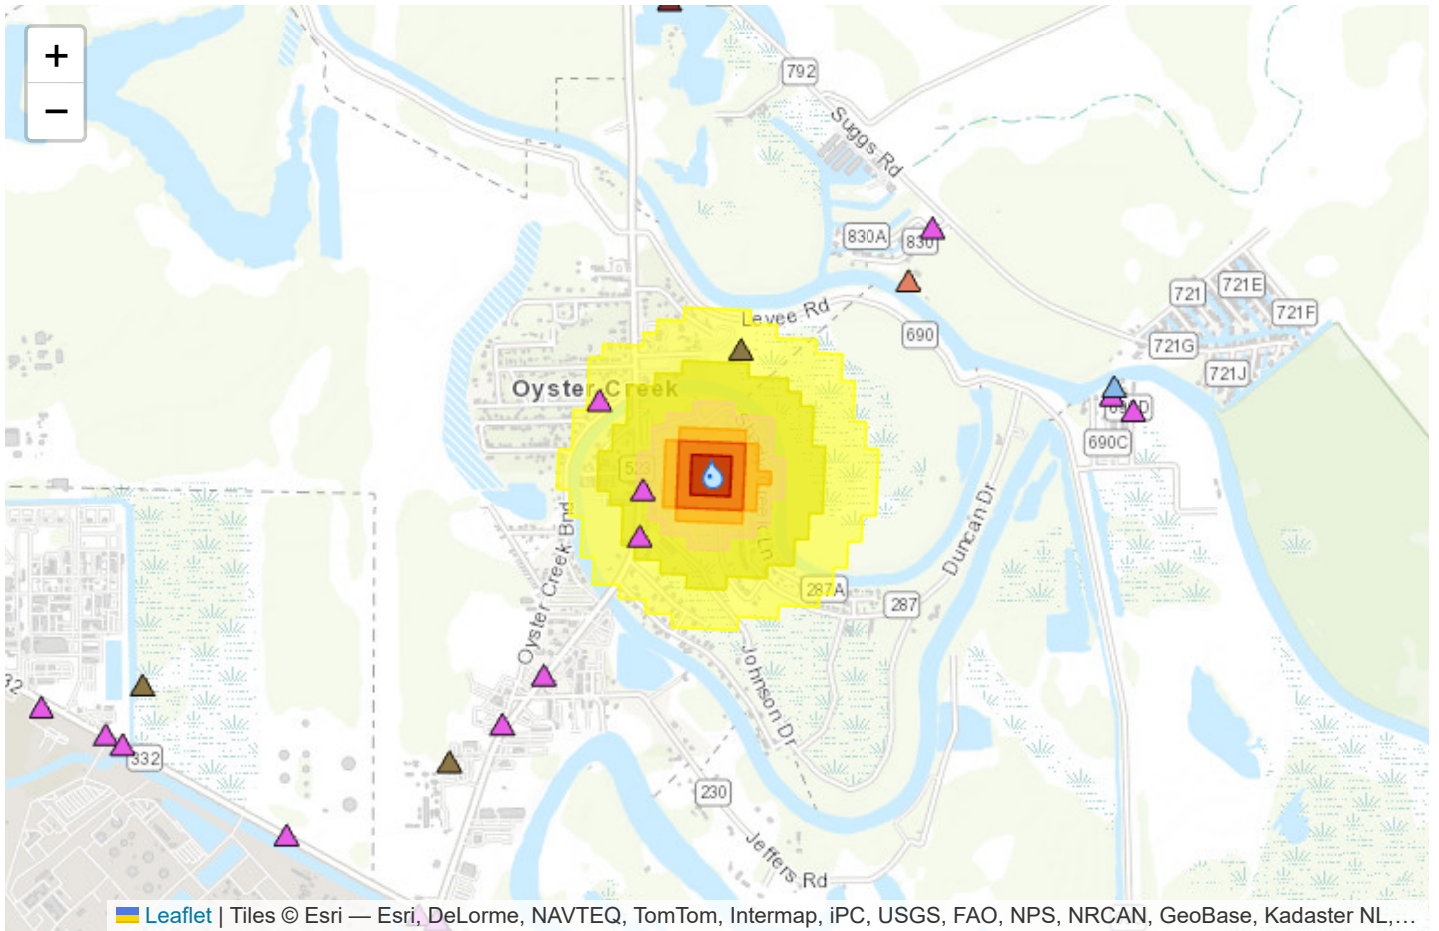


Contaminants with HIGH Susceptibility

No contaminants with high susceptibility.

Contaminants with MODERATE Susceptibility

No contaminants with moderate susceptibility.

Source Details: G0200230B

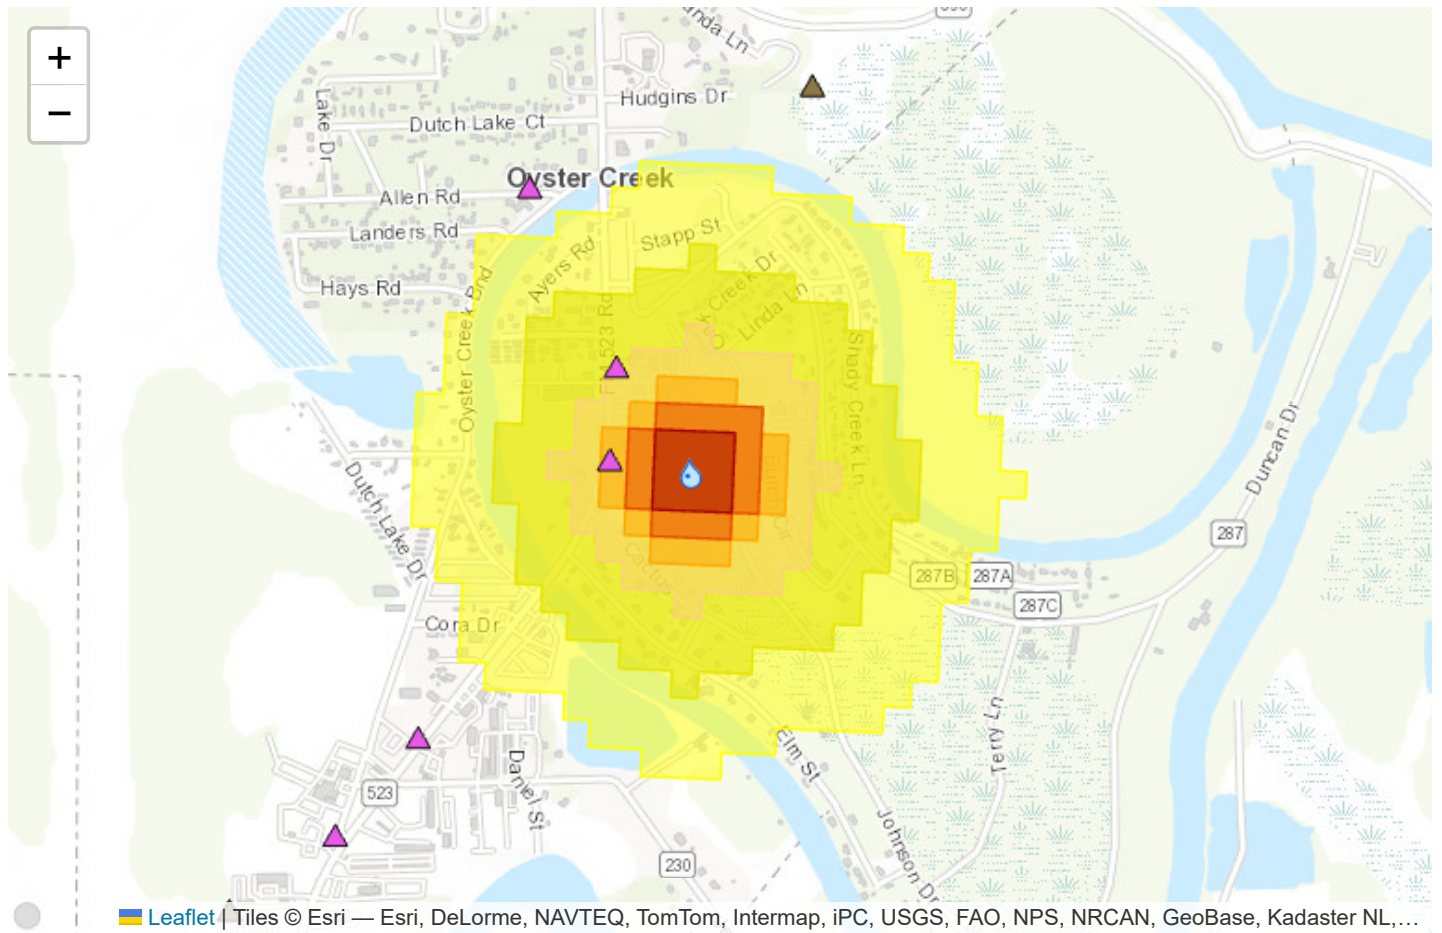

Leaflet | Tiles © Esri — Esri, DeLorme, NAVTEQ, TomTom, Intermap, iPC, USGS, FAO, NPS, NRCAN, GeoBase, Kadaster NL,...

Contaminants with HIGH Susceptibility

No contaminants with high susceptibility.

Contaminants with MODERATE Susceptibility

No contaminants with moderate susceptibility.

Contaminant List

List of regulated and unregulated assessed contaminants grouped by contaminant class. TCEQ Chapter 290 Subchapter F rules are cited for each drinking water standard (secondary drinking water standards are italicized). The TCEQ threshold limit is the concentration used within the contaminant occurrence component to determine if a detection of the chemical was found during water quality monitoring activities. The chemical abstract service (CAS) number is a unique identifier for each chemical.

D.W. CONTAM. CANDIDATE LIST

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CYANAZINE			0.01 ug/L	21725-46-2
DCPA DI-ACID DEGRADATE			0.00 ug/L	2136-79-0
BORON	2.20 mg/L		10.00 ug/L	11113-50-1
2,4,6-TRICHLOROPHENOL	0.08 mg/L		20.00 ug/L	88-06-2
2,4-DICHLOROPHENOL	0.07 mg/L		20.00 ug/L	120-83-2
2,4-DINITROPHENOL	0.05 mg/L		20.00 ug/L	51-28-5
2,4-DINITROTOLUENE	0.00 mg/L		5.00 ug/L	121-14-2
2,6-DINITROTOLUENE	0.00 mg/L		5.00 ug/L	606-20-2
2-METHYLPHENOL	0.05 mg/L		5.00 ug/L	95-48-7
ACETOCHLOR			0.01 ug/L	34256-82-1
1,2-DIPHENYLHYDRAZINE	0.00 mg/L		0.10 ug/L	122-66-7
1,3-DICHLOROPROPENE	0.01 mg/L		0.10 ug/L	542-75-6
PROPAZINE			0.01 ug/L	139-40-2
RDX	0.01 mg/L		0.10 ug/L	121-82-4
TERBACIL			0.01 ug/L	5902-51-2
TERBUFOS			0.01 ug/L	13071-79-9
DCPA MONO-ACID DEGRADATE			0.00 ug/L	887-54-7
DDE	0.00 mg/L		0.01 ug/L	72-55-9
DIAZINON	0.02 mg/L		0.01 ug/L	333-41-5
DISULFOTON	0.00 mg/L		0.01 ug/L	298-04-4
DIURON	0.05 mg/L		0.05 ug/L	330-54-1
EPTC	0.61 mg/L		0.01 ug/L	759-94-4
FONOFOS			0.01 ug/L	944-22-9
LINURON			0.01 ug/L	330-55-2
MOLINATE	0.05 mg/L		0.01 ug/L	2212-67-1
NITROBENZENE	0.01 mg/L		0.10 ug/L	98-95-3
ORGANOTINS				
PERCHLORATE				14797-73-0

INORGANICS

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CHLORIDE		\$290.113	125.00 mg/L	16887-00-6
CHROMIUM	0.10 mg/L	\$290.103(1)	50.00 ug/L	11104-59-9
COPPER	1.30 mg/L	\$290.120	65.00 ug/L	17493-86-6
CYANIDE	0.20 mg/L	\$290.103(1)	0.01 mg/L	57-12-5
BERYLLIUM	0.00 mg/L	\$290.103(1)	2.00 ug/L	14701-08-7
BROMIDE				
CADMIUM	0.01 mg/L	\$290.103(1)	2.50 ug/L	22537-48-0
ALUMINUM	24.44 mg/L	\$290.113	0.10 ug/L	14903-36-7
ANTIMONY	0.01 mg/L	\$290.103(1)	3.00 ug/L	64924-52-3
ARSENIC	0.05 mg/L	\$290.103(1)	10.00 ug/L	15584-04-0
ASBESTOS	7.00 mg/L		-9,999.00 ug/L	1332-21-4
BARIUM	2.00 mg/L	\$290.103(1)	1,000.00 ug/L	16541-35-8
SELENIUM	0.05 mg/L	\$290.103(1)	25.00 ug/L	7782-49-2
SILVER	0.12 mg/L	\$290.113	25.00 ug/L	14701-21-4
SULFATE	500.00 mg/L	\$290.113	125.00 mg/L	14808-79-8
TDS		\$290.113	250.00 mg/L	
THALLIUM	0.00 mg/L	\$290.103(1)	1.00 ug/L	7440-28-0
ZINC	7.33 mg/L	\$290.113	2.50 ug/L	15176-26-8
FLUORIDE	4.00 mg/L	\$290.103(1)	2.00 mg/L	16984-48-8
HYDROGEN SULFIDE		\$290.113	0.00 mg/L	15035-72-0

IRON		\$290.113	150.00 ug/L	15438-31-0
LEAD	0.02 mg/L	\$290.120	0.00 ug/L	14701-27-0
MANGANESE	1.15 mg/L	\$290.113	25.00 ug/L	14333-14-3
MERCURY	0.00 mg/L	\$290.103(1)	1.00 ug/L	14302-87-5
NICKEL	0.49 mg/L	\$290.103(1)	50.00 ug/L	14701-22-5
NITRATE	10.00 mg/L	\$290.103(1)	3.00 mg/L	14797-55-8
NITRATE+NITRITE	10.00 mg/L	\$290.103(1)	3.00 mg/L	none
NITRITE	1.00 mg/L	\$290.103(1)	0.50 mg/L	14797-65-0

INORGANICS MONITORED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CARBONATE			1.00 mg/L	3812-32-6
BICARBONATE			1.00 mg/L	71-52-3
ALKALINITY			1.00 mg/L	
SPECIFIC CONDUCTANCE			1.00 uS/cm	
MAGNESIUM			0.01 mg/L	14581-92-1

INORGANICS UNREGULATED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CALCIUM			0.02 mg/L	14102-48-8
SODIUM			0.20 mg/L	17341-25-2

PHYSICAL

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
HARDNESS			1.00 mg/L	

PHYSICAL PARAMETER

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
pH		\$290.113	0.10 pH	

RADIOCHEM

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
RADIUM-226	5.00 mg/L	\$290.110	1.00 pCi/L	13982-63-3
RADIUM-228	5.00 mg/L	\$290.110	0.50 pCi/L	15262-20-1
STRONTIUM-90		\$290.110	0.50 pCi/L	10098-97-2
TRITIUM		\$290.110	1.00 pCi/L	15086-10-9
GROSS ALPHA	15.00 mg/L	\$290.110	3.00 pCi/L	
GROSS BETA	4.00 mg/L	\$290.110	3.00 pCi/L	

RADIOCHEM UNREGULATED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
RADON	300.00 mg/L		0.50 pCi/L	10043-92-2
STRONTIUM-89			0.50 pCi/L	14701-18-9
URANIUM	0.02 mg/L		1.00 ug/L	none

SOC MONITORED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CHRYSENE	0.13 mg/L		0.10 ug/L	218-01-9
BENZO[B]FLUORANTHENE	0.00 mg/L		10.00 ug/L	205-99-2
BENZO[G,H,I]PERYLENE	0.73 mg/L		10.00 ug/L	191-24-2
BENZO[K]FLUORANTHENE	0.01 ug/L		10.00 ug/L	207-08-9
BROMACIL			0.05 ug/L	314-40-9
BUTACHLOR			0.05 ug/L	23184-66-9
BUTYL BENZYL PHTHALATE	4.89 mg/L		5.00 ug/L	85-68-7

CARBARYL	2.44 mg/L	0.01 ug/L	63-25-2
2,4,5-T	0.24 mg/L	0.05 ug/L	93-76-5
3-HYDROXYCARBOFURAN		0.05 ug/L	16655-82-6
ACENAPHTHENE	1.47 mg/L	5.00 ug/L	83-32-9
ACENAPHTHYLENE	1.47 mg/L	5.00 ug/L	208-96-8
ALDRIN	0.00 mg/L	0.10 ug/L	309-00-2
ANTHRACENE	7.33 mg/L	5.00 ug/L	120-12-7
BENTAZON		0.05 ug/L	25057-89-0
BENZO[A]ANTHRACENE	0.00 mg/L	10.00 ug/L	56-55-3
PHENANTHRENE		5.00 ug/L	85-01-8
PROMETON		0.01 ug/L	1610-18-0
PROPACHLOR		0.01 ug/L	1918-16-7
PYRENE	0.73 mg/L	0.10 ug/L	129-00-0
TRIFLURALIN	0.12 mg/L	0.01 ug/L	1582-09-8
DIBENZ[A,H]ANTHRACENE	0.00 mg/L	10.00 ug/L	53-70-3
DICAMBA	0.73 mg/L	0.05 ug/L	1918-00-9
DIELDRIN	0.00 mg/L	0.01 ug/L	60-57-1
DIETHYL PHTHALATE	19.55 mg/L	5.00 ug/L	84-66-2
DIMETHYL PHTHALATE	19.55 mg/L	5.00 ug/L	131-11-3
DI-N-BUTYL PHTHALATE	2.44 mg/L	5.00 ug/L	84-74-2
FLUORENE	0.98 mg/L	0.10 ug/L	86-73-7
INDENO[1,2,3,CD]PYRENE		10.00 ug/L	193-39-5
LAMBAST		0.05 ug/L	845-52-3
METHIOCARB		0.05 ug/L	2032-65-7
METHOMYL	0.61 mg/L	0.05 ug/L	16752-77-5
METOLACHLOR	3.67 mg/L	0.01 ug/L	51218-45-2
METRIBUZIN		0.01 ug/L	21087-64-9

SOC REGULATED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CHLORDANE	0.00 mg/L	§290.103(3)(A)	0.10 ug/L	57-74-9
CHLORDANE (ALPHA-CHLORDANE)	0.00 mg/L	§290.103(3)(A)	0.10 ug/L	5103-71-9
CHLORDANE (GAMMA-CHLORDANE)	0.00 mg/L	§290.103(3)(A)	0.10 ug/L	12789-03-6
CHLORDANE (TRANS-NONACHLOR)	0.00 mg/L	§290.103(3)(A)	0.10 ug/L	39765-80-5
DALAPON	0.20 mg/L	§290.103(3)(A)	0.05 mg/L	75-99-0
CARBOFURAN	0.04 mg/L	§290.103(3)(A)	0.01 ug/L	1563-66-2
2,3,7,8-TCDD	0.00 mg/L	§290.103(3)(A)	0.10 mg/L	1746-01-6
2,4,5-TP	0.05 mg/L	§290.103(3)(A)	0.05 ug/L	93-72-1
2,4-D	0.07 mg/L	§290.103(3)(A)	0.15 ug/L	94-75-7
ALACHLOR	0.00 mg/L	§290.103(3)(A)	0.01 ug/L	15972-60-8
ALDICARB	0.01 mg/L	§290.103(3)(A)	0.55 ug/L	116-06-3
ALDICARB SULFONE	0.01 mg/L	§290.103(3)(A)	0.10 ug/L	1646-88-4
ALDICARB SULFOXIDE	0.01 mg/L	§290.103(3)(A)	0.05 ug/L	1646-87-3
ATRAZINE	0.00 mg/L	§290.103(3)(A)	0.01 ug/L	1912-24-9
BENZO(A)PYRENE	0.00 mg/L	§290.103(3)(A)	10.00 ug/L	50-32-8
PICLORAM	0.50 mg/L	§290.103(3)(A)	0.05 ug/L	1918-02-1
SIMAZINE	0.00 mg/L		0.01 ug/L	122-34-9
TOXAPHENE	0.00 mg/L	§290.103(3)(A)	2.00 ug/L	8001-35-2
DI-(2-ETHYLHEXYL)ADIPATE	0.40 mg/L	§290.103(3)(A)	5.00 ug/L	103-23-1
DI-(2-ETHYLHEXYL)PHTHALATE	0.01 mg/L	§290.103(3)(A)	5.00 ug/L	117-81-7
DIBROMOCHLOROPROPANE	0.00 mg/L	§290.103(3)(A)	0.10 ug/L	67708-83-2
DINOSEB	0.01 mg/L	§290.103(3)(A)	0.05 ug/L	88-85-7
DIQUAT	0.02 mg/L	§290.103(3)(A)	0.05 mg/L	2764-72-9
ENDOTHALL	0.10 mg/L	§290.103(3)(A)	0.05 ug/L	145-73-3
ENDRIN	0.00 mg/L	§290.103(3)(A)	0.05 ug/L	72-20-8
ETHYLENE DIBROMIDE	0.00 mg/L	§290.103(3)(A)	0.10 ug/L	106-93-4
GLYPHOSATE	0.70 mg/L	§290.103(3)(A)	0.05 ug/L	1071-83-6
HEPTACHLOR	0.00 mg/L	§290.103(3)(A)	0.10 ug/L	76-44-8
HEPTACHLOR EPOXIDE	0.00 mg/L	§290.103(3)(A)	0.10 ug/L	1024-57-3
HEXACHLOROBENZENE	0.00 mg/L	§290.103(3)(A)	5.00 ug/L	118-74-1
HEXACHLOROCYCLOPENTADIENE	0.05 mg/L	§290.103(3)(A)	5.00 ug/L	77-47-4

LINDANE	0.00 mg/L	\$290.103(3)(A)	0.01 ug/L	58-89-9
METHOXYCHLOR	0.04 mg/L	\$290.103(3)(A)	0.05 ug/L	72-43-5
OXAMYL	0.20 mg/L	\$290.103(3)(A)	0.05 ug/L	23135-22-0
PCBs	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	53469-21-9
PENTACHLOROPHENOL	0.00 mg/L	\$290.103(3)(A)	30.00 ug/L	87-86-5

THM

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CHLOROFORM	0.10 mg/L	\$290.116	0.10 ug/L	67-66-3
BROMOCHLOROMETHANE	0.98 mg/L		0.10 ug/L	74-97-5
BROMODICHLOROMETHANE	0.10 mg/L	\$290.116	0.10 ug/L	75-27-4
BROMOFORM	0.10 mg/L	\$290.116	0.10 ug/L	75-25-2
BROMOMETHANE	0.03 mg/L		0.10 ug/L	74-83-9
DIBROMOCHLOROMETHANE	0.10 mg/L	\$290.116	0.10 ug/L	124-48-1

VOC - OTHER COMPOUNDS

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CARBON DISULFIDE	2.44 mg/L		0.10 ug/L	75-15-0
2-HEXANONE	1.47 mg/L		0.10 ug/L	591-78-6
4-METHYL-2-PENTANONE (MIBK)	1.96 mg/L		0.10 ug/L	108-10-1
ACETONE	2.44 mg/L		0.10 ug/L	67-64-1
ACRYLONITRILE	0.00 mg/L		0.10 ug/L	107-13-1
TETRAHYDROFURAN	0.12 mg/L		0.10 ug/L	109-99-9
VINYL ACETATE	24.44 mg/L		0.10 ug/L	108-05-4
ETHYL METHACRYLATE	2.20 mg/L		0.10 ug/L	97-63-2
METHYL IODIDE (IODOMETHANE)	0.03 mg/L		0.10 ug/L	74-88-4
METHYL ETHYL KETONE	14.67 mg/L		0.10 ug/L	78-93-3
METHYL METHACRYLATE	34.22 mg/L		0.10 ug/L	80-62-6
METHYL-T-BUTYL ETHER	0.24 mg/L		0.10 ug/L	1634-04-4

VOC MONITORED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CHLOROETHANE	9.78 mg/L		0.10 ug/L	75-00-3
CHLOROMETHANE	0.07 mg/L		0.10 ug/L	74-87-3
CIS-1,3-DICHLOROPROPENE	0.00 mg/L		0.10 ug/L	10061-01-5
BROMOBENZENE	0.49 mg/L		0.10 ug/L	108-86-1
2-CHLOROTOLUENE	0.49 mg/L		0.10 ug/L	95-49-8
4-CHLOROTOLUENE	0.49 mg/L		0.10 ug/L	106-43-4
4-ISOPROPYLTOLUENE	2.44 mg/L		0.10 ug/L	99-87-6
1,1,1,2-TETRACHLOROETHANE	0.04 mg/L		0.10 ug/L	630-20-6
1,1,2,2-TETRACHLOROETHANE	0.17 mg/L		0.10 ug/L	79-34-5
1,1-DICHLOROETHANE	2.44 mg/L		0.10 ug/L	75-34-3
1,1-DICHLOROPROPENE	0.01 mg/L		0.10 ug/L	563-58-6
1,2,3-TRICHLOROBENZENE	0.07 mg/L		0.10 ug/L	87-61-6
1,2,3-TRICHLOROPROPANE	0.00 mg/L		0.10 ug/L	96-18-4
1,2,4-TRIMETHYLBENZENE	1.22 mg/L		0.10 ug/L	95-63-6
1,3,5-TRIMETHYLBENZENE	1.22 mg/L		0.10 ug/L	108-67-8
1,3-DICHLOROBENZENE	0.73 mg/L		0.10 ug/L	541-73-1
1,3-DICHLOROPROPANE	0.01 mg/L		0.10 ug/L	142-28-9
2,2-DICHLOROPROPANE			0.10 ug/L	594-20-7
S-BUTYLBENZENE	0.98 mg/L		0.10 ug/L	135-98-8
T-BUTYLBENZENE	0.98 mg/L		0.10 ug/L	98-06-6
TRANS-1,3-DICHLOROPROPENE	0.01 mg/L		0.10 ug/L	10061-02-6
TRICHLOROFLUOROMETHANE	7.33 mg/L		0.10 ug/L	75-69-4
DIBROMOMETHANE	0.12 mg/L		0.10 ug/L	74-95-3
DICHLORODIFLUOROMETHANE	4.89 mg/L		0.10 ug/L	75-71-8
HEXACHLOROBUTADIENE	0.00 ug/L		0.10 ug/L	87-68-3
ISOPROPYLBENZENE	2.44 mg/L		0.10 ug/L	98-82-8

M + P XYLENE		0.10 ug/L	106-42-3
NAPHTHALENE	0.49 mg/L	0.10 ug/L	91-20-3
N-BUTYLBENZENE	0.98 mg/L	0.10 ug/L	104-51-8
N-PROPYLBENZENE	0.98 mg/L	0.10 ug/L	103-65-1

VOC REGULATED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CHLOROBENZENE (MONOCHLOROBENZENE)	0.10 mg/L		0.10 ug/L	108-90-7
CIS-1,2-DICHLOROETHYLENE	0.07 mg/L	\$290.103(3)(B)	0.10 ug/L	156-59-2
CARBON TETRACHLORIDE	0.00 mg/L	\$290.103(3)(B)	0.10 ug/L	56-23-5
1,1,1-TRICHLOROETHANE	0.20 mg/L	\$290.103(3)(B)	0.10 ug/L	71-55-6
1,1,2-TRICHLOROETHANE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	79-00-5
1,1-DICHLOROETHYLENE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	75-35-4
1,2,4-TRICHLOROBENZENE	0.07 mg/L	\$290.103(3)(B)	0.10 ug/L	120-82-1
1,2-DICHLOROETHANE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	107-06-2
1,2-DICHLOROPROPANE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	78-87-5
BENZENE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	71-43-2
P-XYLENE		\$290.103(3)(B)	0.10 ug/L	106-42-3
STYRENE	0.10 mg/L	\$290.103(3)(B)	0.10 ug/L	100-42-5
TETRACHLOROETHYLENE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	127-18-4
TOLUENE	1.00 mg/L	\$290.103(3)(B)	0.10 ug/L	108-88-3
TRANS-1,2-DICHLOROETHYLENE	0.10 mg/L	\$290.103(3)(B)	0.10 ug/L	156-60-5
TRICHLOROETHYLENE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	79-01-6
VINYL CHLORIDE	0.00 mg/L	\$290.103(3)(B)	0.10 ug/L	75-01-4
XYLENES (TOTAL)	10.00 mg/L	\$290.103(3)(B)	0.10 ug/L	none
DICHLOROMETHANE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	75-09-2
ETHYLBENZENE	0.70 mg/L	\$290.103(3)(B)	0.10 ug/L	100-41-4
MONOCHLOROBENZENE (CHLOROBENZENE)		\$290.103(3)(B)	0.10 ug/L	108-90-7
M-XYLENE	10.00 mg/L		0.10 mg/L	108-38-3
ORTHO-1,2-DICHLOROBENZENE	0.60 mg/L	\$290.103(3)(B)	0.10 ug/L	95-50-1
O-XYLENE		\$290.103(3)(B)	0.10 mg/L	95-47-6
PARA-1,4-DICHLOROBENZENE	0.08 mg/L	\$290.103(3)(B)	0.10 ug/L	106-46-7

Other

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CRYPTOSPORIDIUM PARVUM				
AROCLOR (PCB)			0.05 ug/L	53469-21-9
TOTAL ALPHA EMITTING RADIUM	5.00 mg/L	\$290.110		
TOTAL COLIFORM				
TOTAL TRIHALOMETHANE	0.10 mg/L	\$290.116	0.10 ug/L	
TRIAZINES				
ESCHERICHIA COLI				
FECAL VIRUSES				
GIARDIA LAMBLIA				
P-ALKALINITY				


Map Legend

Water System Sources

Source Type

Source Type

 Surface Water

 Ground Water

Capture Zones

Travel Time

 2 Years

 5 Years

 10 Years

 20 Years

 50 Years

 100 Years

 Other

Truncated Watersheds



Potential Sources of Contamination

Type Description

 ANIMAL FEEDING OPERATION

 BUSINESS

 CEMETERY

 CHEMICAL PIPELINE

 CHEMICAL STORAGE

 CLASS I INJECTION WELL

 CLASS II INJECTION WELL

 CLASS III INJECTION WELL

 CLASS IV INJECTION WELL

 CLASS V INJECTION WELL

 GUN RANGE

 NATURAL RESOURCE PRODUCTION

API



 TRANSPORTATION

 WASTE

 WASTEWATER
